

Standard Symbol

BMP Objectives

- Soil Stabilization
- Sediment Control
- Tracking Control
- Wind Erosion Control
- Non-Storm Water Management
- Materials and Waste Management

Definition and Purpose

Dewatering Operations are practices that manage the discharge of pollutants when non-storm water and accumulated precipitation (storm water) must be removed from a work location so that construction work may be accomplished.

Appropriate Applications

- These practices are implemented for discharges of non-storm water and storm water (accumulated rain water) from construction sites. Non-storm water includes, but is not limited to, groundwater, dewatering of piles, water from cofferdams, water diversions, and water used during construction activities that must be removed from a work area.
- Practices identified in this section are also appropriate for implementation when managing the removal of accumulated precipitation (storm water) from depressed areas at a construction site.
- Storm water mixed with non-storm water should be managed as non-storm water.

Limitations

- Dewatering operations for non-storm water will require, and must comply with, applicable local permits, project-specific permits, and regulations.
- Site conditions will dictate design and use of dewatering operations.
- A dewatering plan shall be submitted as part of the SWPPP/WPCP detailing the location of dewatering activities, equipment, and discharge point.
- The controls discussed in this best management practice (BMP) address sediment only. If the presence of polluted water with hazardous substances is identified in the contract, the contractor shall implement dewatering pollution controls as required by the contract documents. If the quality of water to be removed by dewatering is not identified as polluted in the contract documents, but is later determined by observation or testing to be polluted, the contractor shall notify the Resident Engineer (RE) and comply with Standard Specifications Section 5-1.116, "Differing Site Conditions."


Standards and Specifications

- Avoid dewatering discharges where possible by using the water for dust control, by infiltration, etc.
- Dewatering shall be conducted in accordance with the Field Guide to Construction Site Dewatering, October 2001, CTSW-RT-01-010.
- Dewatering for accumulated precipitation (storm water) shall follow this BMP and use treatment measures specified herein.
- The RWQCB may require a separate NPDES permit prior to the dewatering discharge of non-storm water. These permits will have specific testing, monitoring, and discharge requirements and can take significant time to obtain.
- Except in RWQCB Regions 1 and 2, the discharge of accumulated precipitation (storm water) to a water body or storm drain is subject to the requirements of Caltrans NPDES permit. Sediment control and other appropriate BMPs (e.g., outlet protection/energy dissipation) must be employed when this water is discharged.
- RWQCB Regions 1 and 2 require notification and approval prior to any discharge of water from construction sites.
- In RWQCB Regions 3, 5, 7, and 9 non-storm water dewatering for discharges meeting certain conditions are allowed under an RWQCB general dewatering NPDES Permit. Notification and approval from the RWQCB is required prior to conducting these operations. This includes storm water that is mixed with groundwater or other non-storm water sources. Once the discharge is allowed, appropriate BMPs must be implemented to ensure that the discharge complies with all permit requirements. Conditions for potential discharge under an RWQCB general dewatering NPDES Permit include:
 - Regions 3, 5, 7: Non-storm water discharges, free of pollutants other than sediment, <0.25 MGD, with a duration of 4 or fewer months.
 - Region 9: Groundwater, free of pollutants other than sediment, <0.10 MGD, to surface waters other than San Diego Bay.
- The flow chart shown on Page 4 shall be utilized to guide dewatering operations.
- The RE will coordinate monitoring and permit compliance.
- Discharges must comply with regional and watershed-specific discharge requirements.
- Additional permits or permissions from other agencies may be required for dewatering cofferdams or diversions.
- Dewatering discharges must not cause erosion at the discharge point.

Maintenance and Inspection

- Dewatering records shall be maintained for a period of 3 years.
- Inspect all BMPs implemented to comply with permit requirements frequently and repair or replace to ensure the BMPs function as designed.
- Conduct water quality monitoring pursuant to the “Storm Water Dewatering Operations BMP Discharge Monitoring Forms”.
- Accumulated sediment removed during the maintenance of a dewatering device may be incorporated in the project at locations designated by the RE or disposed of outside the right-of-way in conformance with the Standard Specifications.
- Accumulated sediment that is commingled with other pollutants must be disposed of in accordance with all applicable laws and regulations and as approved by the RE.

Dewatering Operations

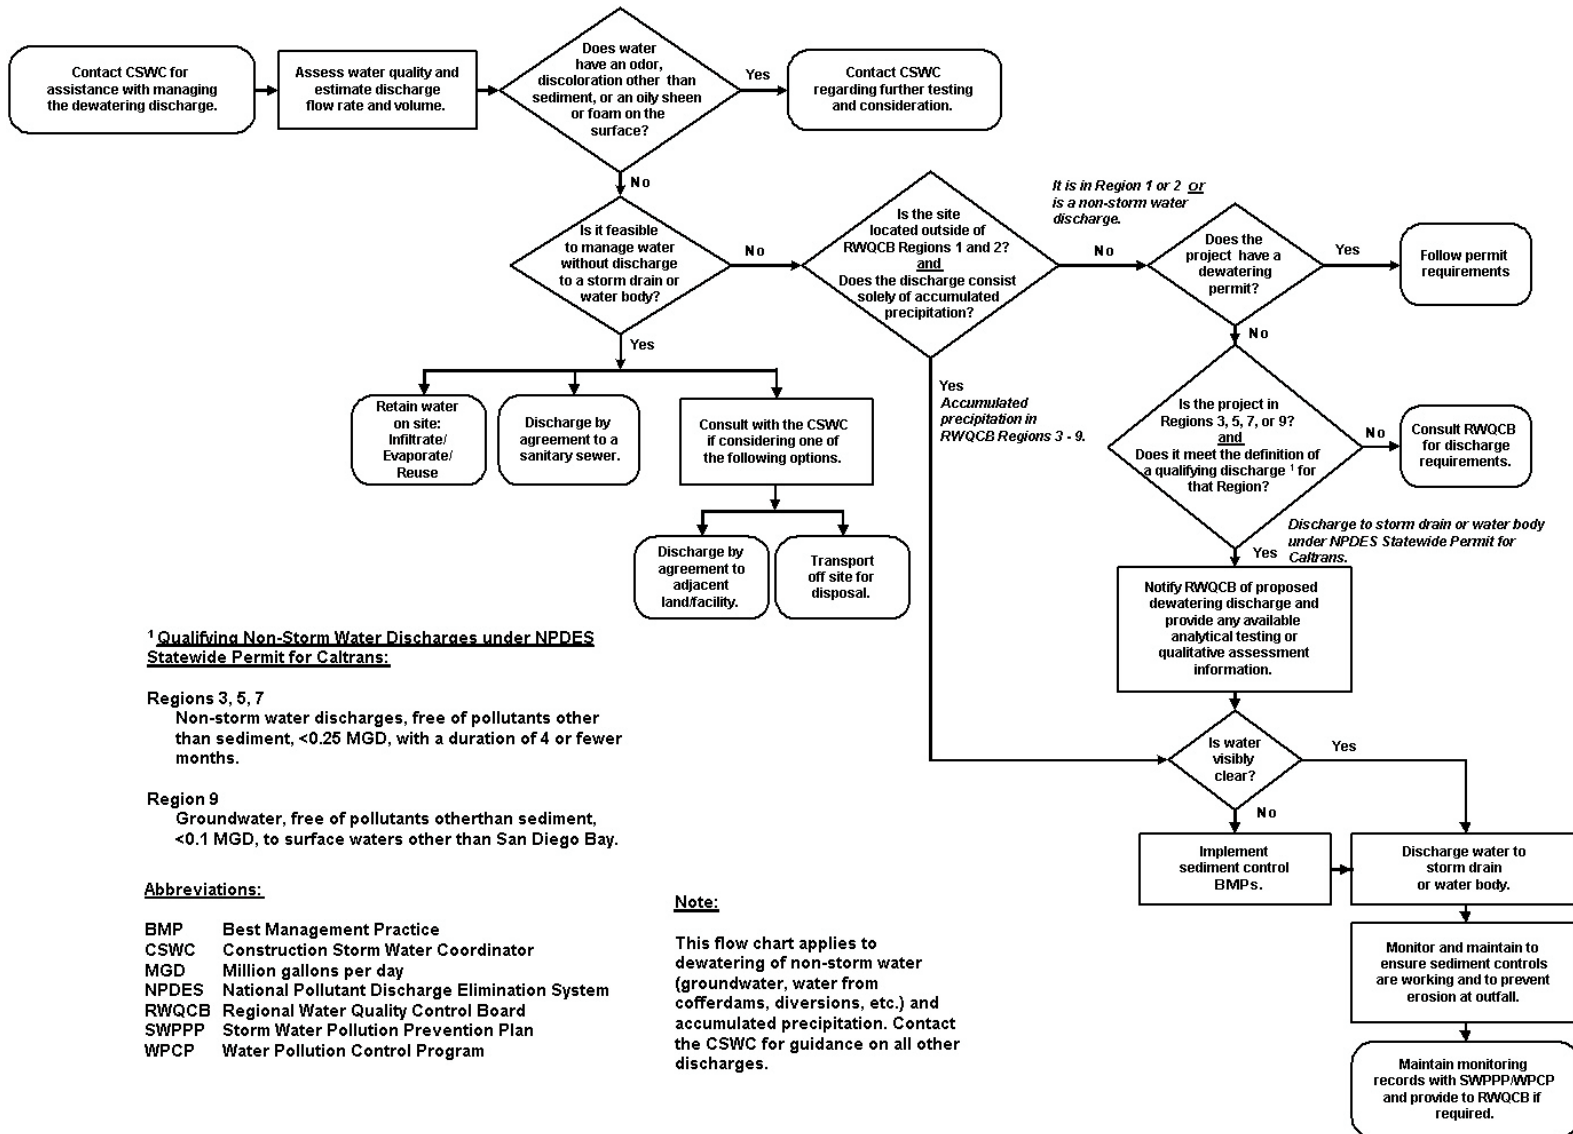

=

Sediment Treatment A variety of methods can be used to treat water during dewatering operations from the construction site. Several devices are presented in this section that provide options to achieve sediment removal. The size of particles present in the sediment and Permit or receiving water limitations on sediment are key considerations for selecting sediment treatment option(s); in some cases, the use of multiple devices may be appropriate.

Category 1: Constructed Settling Technologies

The devices discussed in this category are to be used exclusively for dewatering operations only.

Sediment/Desilting Basin (SC-2)

Description:

A desilting basin is a temporary basin with a controlled release structure that is formed by excavation and/or construction of an embankment to detain sediment-laden runoff and allow sediment to settle out before discharging.

Appropriate Applications:

- Effective for the removal of trash, gravel, sand, and silt and some metals that settle out with the sediment.

Implementation:

- Excavation and construction of related facilities is required.
- Temporary desilting basins must be fenced if safety is a concern.
- Outlet protection is required to prevent erosion at the outfall location.

Maintenance:

- Maintenance is required for safety fencing, vegetation, embankment, inlet and outfall structures, as well as other features.
- Removal of sediment is required when the storage volume is reduced by one-third.

Sediment Trap (SC-3)

Description:

A sediment trap is a temporary basin formed by excavation and/or construction of an earthen embankment across a waterway or low drainage area to detain sediment-laden runoff and allow sediment to settle out before discharging.

Appropriate Applications:

- Effective for the removal of large and medium sized particles (sand and gravel) and some metals that settle out with the sediment.

Implementation:

- Excavation and construction of related facilities is required.
- Trap inlets shall be located to maximize the travel distance to the trap outlet.
- Use rock or vegetation to protect the trap outlets against erosion.

Maintenance:

- Maintenance is required for vegetation, embankment, inlet and outfall structures, as well as other features.
- Removal of sediment is required when the storage volume is reduced by one-third.

Category 2: Mobile Settling Technologies

The devices discussed in this category are typical of tanks that can be used for sediment treatment of dewatering operations. A variety of vendors are available who supply these tanks.

Weir Tank

Description:

A weir tank separates water and waste by using weirs. The configuration of the weirs (over and under weirs) maximizes the residence time in the tank and determines the waste to be removed from the water, such as oil, grease, and sediments.

Appropriate Applications:

- The tank removes trash, some settleable solids (gravel, sand, and silt), some visible oil and grease, and some metals (removed with sediment). To achieve high levels of flow, multiple tanks can be used in parallel. If additional treatment is desired, the tanks can be placed in series or as pre-treatment for other methods.


Implementation:

- Tanks are delivered to the site by the vendor, who can provide assistance with set-up and operation.
- Tank size will depend on flow volume, constituents of concern, and residency period required. Vendors shall be consulted to appropriately size tank.

Maintenance:

- Periodic cleaning is required based on visual inspection or reduced flow.
- Oil and grease disposal must be by licensed waste disposal company.

Schematic Diagrams:

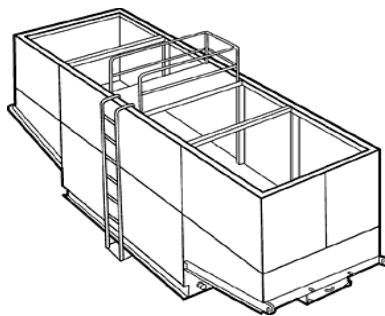

Weir Tanks

Dewatering Tank

Description:

A dewatering tank removes debris and sediment. Flow enters the tank through the top, passes through a fabric filter, and is discharged through the bottom of the tank. The filter separates the solids from the liquids.

Appropriate Applications:

- The tank removes trash, gravel, sand, and silt, some visible oil and grease, and some metals (removed with sediment). To achieve high levels of flow, multiple tanks can be used in parallel. If additional treatment is desired, the tanks can be placed in series or as pre-treatment for other methods.

Implementation:

- Tanks are delivered to the site by the vendor, who can provide assistance with set-up and operation.
- Tank size will depend on flow volume, constituents of concern, and residency period required. Vendors shall be consulted to appropriately size tank.

Maintenance:

- Periodic cleaning is required based on visual inspection or reduced flow.
- Oil and grease disposal must be by licensed waste disposal company.

Schematic Diagrams:



Dewatering Tanks

Category 3: Basic Filtration Technologies

Gravity Bag Filter

Description:

A gravity bag filter, also referred to as a dewatering bag, is a square or rectangular bag made of non-woven geotextile fabric that collects sand, silt, and fines.

Appropriate Applications:

- Effective for the removal of sediments (gravel, sand, and silt). Some metals are removed with the sediment.


Implementation:

- Water is pumped into one side of the bag and seeps through the bottom and sides of the bag.
- A secondary barrier, such as a rock filter bed or straw/hay bale barrier, is placed beneath and beyond the edges of the bag to capture sediments that escape the bag.

Maintenance:

- Inspection of the flow conditions, bag condition, bag capacity, and the secondary barrier is required.
- Replace the bag when it no longer filters sediment or passes water at a reasonable rate.
- The bag is disposed off-site, or on-site as directed by the RE.

Schematic Diagrams:

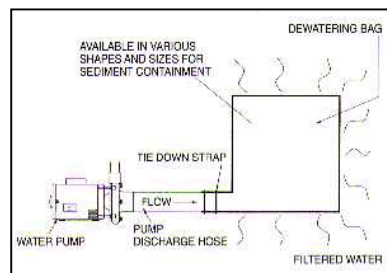

Gravity Bag Filter

Category 4: Advanced Filtration Technologies

Sand Media Particulate Filter

Description:

Water is treated by passing it through canisters filled with sand media. Generally, sand filters provide a final level of treatment. They are often used as a secondary or higher level of treatment after a significant amount of sediment and other pollutants have been removed.

Appropriate Applications:

- Effective for the removal of trash, gravel, sand, and silt and some metals, as well as the reduction of biochemical oxygen demand (BOD) and turbidity.
- Sand filters can be used for standalone treatment or in conjunction with bag and cartridge filtration if further treatment is required.
- Sand filters can also be used to provide additional treatment to water treated via settling or basic filtration.

Implementation:

- The filters require delivery to the site and initial set up. The vendor can provide assistance with installation and operation.

Maintenance:

- The filters require monthly service to monitor and maintain the sand media.

Schematic Diagrams:



Sand Media Particulate Filters

Pressurized Bag Filter

Description:

A pressurized bag filter is a unit composed of single filter bags made from polyester felt material. The water filters through the unit and is discharged through a header, allowing for the discharge of flow in series to an additional treatment unit. Vendors provide pressurized bag filters in a variety of configurations. Some units include a combination of bag filters and cartridge filters for enhanced contaminant removal.

Appropriate Applications:

- Effective for the removal of sediment (sand and silt) and some metals, as well as the reduction of BOD, turbidity, and hydrocarbons. Oil absorbent bags are available for hydrocarbon removal.
- Filters can be used to provide secondary treatment to water treated via settling or basic filtration.

Implementation:

- The filters require delivery to the site and initial set up. The vendor can provide assistance with installation and operation.

Maintenance:

- The filter bags require replacement when the pressure differential exceeds the manufacturer's recommendation.

Schematic Diagrams:



Pressurized Bag Filter

Cartridge Filter

Description:

Cartridge filters provide a high degree of pollutant removal by utilizing a number of individual cartridges as part of a larger filtering unit. They are often used as a secondary or higher (polishing) level of treatment after a significant amount of sediment and other pollutants are removed. Units come with various cartridge configurations (for use in series with pressurized bag filters) or with a larger single cartridge filtration unit (with multiple filters within).

Appropriate Applications:

- Effective for the removal of sediment (sand, silt, and some clays) and metals, as well as the reduction of BOD, turbidity, and hydrocarbons. Hydrocarbons can effectively be removed with special resin cartridges.
- Filters can be used to provide secondary treatment to water treated via settling or basic filtration.

Implementation:

- The filters require delivery to the site and initial set up. The vendor can provide assistance.

Maintenance:

- The cartridges require replacement when the pressure differential exceeds the manufacturer's recommendation.

Schematic Designs:



Cartridge Filter

Dewatering Operations

NS-2

STORM WATER DEWATERING OPERATIONS BMP DISCHARGE MONITORING FORM ^a	
Central Coast Region (RWQCB 3) For Inland Surface Waters ^b	
GENERAL INFORMATION	
Project Name	
Contract No	
Contractor	
Sampler's Name	
Sampler's Signature	
Date Discharge Began	
Date of Sampling	

WATER SAMPLE LOG ^{c, d, e}				
Constituents	Units	Results		
		Effluent	Receiving Water ^f	
			Upstream (R-1)	Downstream (R-2)
Dissolved Oxygen	mg/L			
pH	unitless			
Turbidity	JTUs			

DISCHARGE LIMITATIONS ^{g, h, i}					
Constituent	Units	EFFLUENT		RECEIVING WATER	
		Daily Maximum		Daily Maximum	
Dissolved Oxygen	mg/L	--		5.0 ^j	
pH	unitless	--		Between 7.0 - 8.5 ^j	
Turbidity	JTUs	--		20% (Where Ambient is 0 - 50 JTUs)	
				10 (Where Ambient is 50 - 100 JTUs)	
				10% (Where Ambient is > 100 JTUs)	

NOTES:

Ambient - Upstream sample result (i.e., R-1)
 BMP - Best Management Practice
 JTUs - Jackson turbidity units
 mg/L - Milligrams per liter

RWQCB - Regional Water Quality Control Board
 SAR - Sodium absorption ratio
 -- - Not required
 > - Greater Than

a This form shall be used only for dewatering of storm water/accumulated precipitation. Dewatering non-storm water shall monitor constituents required in the applicable NPDE permit or Waste Discharge Requirements.

b All inland surface waters, enclosed bays, and estuaries. Based on the 1994 RWQCB 3 Basin Plan.
 [http://www.swrcb.ca.gov/rwqcb3/BasinPlan/Index.htm]

c Collect monthly samples. The first sample shall be collected at the start of the discharge and the last sample shall be collected at the completion of the discharge. Use the same sample collection criteria for discharges less than one month in duration for a total of two samples per discharge event.

d Each constituent will be analyzed in the effluent and the two receiving water samples.

e Dissolved oxygen, pH, and turbidity are required to be analyzed throughout the basin.

The following constituents shall be sampled if suspected to present in the discharge: ammonia for toxicity, MBAS, PCBs, phenols, and phthalate esters are required to be analyzed throughout the basin, however, bacteria, boron, chemical color, temperature, and total dissolved solids shall be analyzed if the project lies in an area designated for a specific beneficial use, as noted in the Basin Plan.

f R-1 shall be collected 100 feet upstream from the closest point of discharge. R-2 shall be collected 100 feet downstream from the closest point of discharge.

g If the results from receiving water sample exceed any of the discharge limits then discontinue dewatering activities to surface waters.

h All discharge limitations are listed in the Water Quality Objectives Section of the Basin Plan.

i Water shall not contain concentrations that cause nuisance or adversely affect beneficial uses of the following: Biostimulatory substances, floating material, oil and grease, pesticides, sediment, settleable materials, suspended materials, and tastes and odors.

j In addition, dissolved oxygen and pH have specific beneficial uses discharge limitations. See basin plan for specific limitations.



Dewatering Operations

NS-2

STORM WATER DEWATERING OPERATIONS BMP DISCHARGE MONITORING FORM^a	
Los Angeles Region (RWQCB 4) Los Angeles and Ventura Counties For Inland Surface Waters ^b	
GENERAL INFORMATION	
Project Name	
Contract No	
Contractor	
Sampler's Name	
Sampler's Signature	
Date Discharge Began	
Date of Sampling	

WATER SAMPLE LOG ^{c, d, e}				
Constituents	Units	Results		
		Effluent	Receiving Water ^f	
			Upstream (R-1)	Downstream (R-2)
pH	unitless			
Turbidity	NTUs			
TDS ^l	mg/L			

DISCHARGE LIMITATIONS ^{g, h, k, i}			
Constituent	Units	EFFLUENT	RECEIVING WATER
		Daily Maximum	Daily Maximum
pH	unitless	--	Between 6.5 - 8.5 ^j
Turbidity	NTUs	--	20% (Where Ambient is 0 - 50 NTUs)
TDS	mg/L	--	10% (Where Ambient is > 50 NTUs)
			See Table 3-8 in Basin Plan

NOTES:

Ambient - Upstream sample result (ie. R-1)
BMP - Best Management Practice
mg/L - Milligrams per liter

NTUs - Nephelometric turbidity units
RWQCB - Regional Water Quality Control Board
-- - Not required
> - Greater Than

a This form shall be used only for dewatering of storm water/accumulated precipitation. Dewatering non-storm water shall monitor constituents required in the applicable NPDES permit or Waste Discharge Requirements.

b All inland surface waters, enclosed bays, and estuaries, including wetlands. Based on the 1995 RWQCB 4 Basin Plan.
[http://www.swrcb.ca.gov/rwqcb4/html/meetings/tmdl/Basin_plan/basin_plan_doc.html]

c Collect monthly samples. The first sample shall be collected at the start of the discharge and the last sample shall be collected at the completion of the discharge. Use the same sample collection criteria for discharges less than one month in duration for a total of two samples per discharge event.

d Each constituent will be analyzed in the effluent and the two receiving water samples.

e pH, and turbidity are required to be analyzed throughout the basin, however, ammonia, bacteria/coliform, boron, chemical constituents, chloride, dissolved oxygen, methylene blue activated substances, nitrogen, pesticides, polychlorinated biphenyls, radioactive substances, sodium absorption ratio, sulfate, temperature, and total dissolved solids shall be analyzed if the project lies in an area designated for a specific beneficial use, as noted in the Basin Plan.

f R-1 shall be collected 100 feet upstream from the closest point of discharge. R-2 shall be collected 100 feet downstream from the closest point of discharge.

g If the results from receiving water sample exceed any of the discharge limits then discontinue dewatering activities to surface waters

h All discharge limitations are listed in the Water Quality Objectives Section of the Basin Plan.

i Water shall not contain concentrations that cause nuisance or adversely affect beneficial uses of the following: Bioaccumulation, biochemical oxygen demand, biostimulatory substances, color, exotic vegetation, floating material, oil and grease, solid/suspended/settleable materials, tastes and odors, and toxicity.

j In addition, ambient pH levels shall not be changed more than 0.2 units for inland surface waters, and 0.5 for bays or estuaries from natural conditions.

k See Table 3-8 in Basin Plan for applicable watershed



Dewatering Operations

NS-2

STORM WATER DEWATERING OPERATIONS BMP DISCHARGE MONITORING FORM ^a	
Central Valley Region (RWQCB 5) Sacramento River Basin and The San Joaquin River Basin For Inland Surface Waters ^b	
GENERAL INFORMATION	
Project Name	
Contract No.	
Contractor	
Sampler's Name	
Sampler's Signature	
Date Discharge Began	
Date of Sampling	

WATER SAMPLE LOG ^{c, d, e}			
Constituents	Units	Results	
		Effluent	Receiving Water ^f
			Upstream (R-1) Downstream (R-2)
pH	unitless		
Turbidity	NTUs		

DISCHARGE LIMITATIONS ^{g, h, i}			
Constituent	Units	EFFLUENT	RECEIVING WATER
		Daily Maximum	Daily Maximum
pH	unitless	--	Between 6.5 - 8.5
Turbidity	NTUs	--	1 NTU increase (Where Ambient is 0 - 5 NTUs)
			20% increase (Where Ambient is 5 - 50 NTUs)
			10 NTU increase (Where Ambient is 50 - 100 NTUs)
			10% increase (Where Ambient is > 100 NTUs)

NOTES:

- Ambient - Upstream sample result (i.e., R-1) RWQCB - Regional Water Quality Control Board
- BMP - Best Management Practice -- - Not required
- NTUs - Nephelometric turbidity units > - Greater Than

a This form shall be used only for dewatering of storm water/accumulated precipitation. Dewatering non-storm water shall monitor constituents required in the applicable NPDES permit or Waste Discharge Requirements.

^b All surface waters in the Sacramento and San Joaquin River Basins, including the Delta. Based on the 1998 RWQCB 5a/5b Basin Plan. [\[http://www.swrcb.ca.gov/rwqcb5/available_documents/index.html#anchor616381\]](http://www.swrcb.ca.gov/rwqcb5/available_documents/index.html#anchor616381)

^c Collect monthly samples. The first sample shall be collected at the start of the discharge and the last sample shall be collected at the completion of the discharge. Use the same sample collection criteria for discharges less than one month in duration for a total of two samples per discharge event.

^d Each constituent will be analyzed in the effluent and the two receiving water samples.

^e Turbidity and pH are required to be analyzed throughout the basin, however, bacteria, chemical constituents, dissolved oxygen, pesticides, radioactivity, salinity, and temperature shall be analyzed if the project lies in an area designated for a specific beneficial use or along a specific waterbody, as noted in the Basin Plan.

^f R-1 shall be collected 100 feet upstream from the closest point of discharge. R-2 shall be collected 100 feet downstream from the closest point of discharge.

^g If the results from receiving water sample exceed any of the discharge limits then discontinue dewatering activities to surface water

^h All discharge limitations are listed in the Water Quality Objectives Section of the Basin Plan

ⁱ Water shall not contain concentrations that cause nuisance or adversely affect beneficial uses of the following: Biostimulatory substances, color, floating material, oil and grease, sediment, settleable material, suspended material, tastes and odors, and toxicity.



Dewatering Operations

NS-2

STORM WATER DEWATERING OPERATIONS BMP DISCHARGE MONITORING FORM ^a	
Central Valley Region (RWQCB 5) Tulare Lake Basin For Inland Surface Waters ^b	
GENERAL INFORMATION	
Project Name	
Contract No	
Contractor	
Sampler's Name	
Sampler's Signature	
Date Discharge Began	
Date of Sampling	

WATER SAMPLE LOG ^{c, d, e}				
Constituents	Units	Results		
		Effluent	Receiving Water ^f	
			Upstream (R-1)	Downstream (R-2)
pH	unitless			
Turbidity	NTUs			
Dissolved Oxygen	mg/L			
Electrical Conductivity	umho/cm			

DISCHARGE LIMITATIONS ^{g, h, i}			
Constituent	Units	EFFLUENT	RECEIVING WATER
		Daily Maximum	Daily Maximum
pH	unitless	--	Between 6.5 - 8.3
Turbidity	NTUs	--	0.3 unit change for background
			1 (Where Ambient is 0 - 5 NTUs)
			20% (Where Ambient is 5 - 50 NTUs)
			10 (Where Ambient is 50 - 100 NTUs)
Dissolved Oxygen	mg/L		10% (Where Ambient is > 100 NTUs)
			See Table III-1 in Basin Plan
Electrical Conductivity	umho/cm		See Table III-2 in Basin Plan

NOTES:

Ambient - Upstream sample result (i.e., R-1)
 BMP - Best Management Practice
 cm - Centimeter
 mg/L - Milligrams per liter

NTUs - Nephelometric turbidity units
 RWQCB - Regional Water Quality Control Board
 -- - Not required
 > - Greater Than

^a This form shall be used only for dewatering of storm water/accumulated precipitation. Dewatering non-storm water shall monitor constituents required in the applicable NPDES permit or Waste Discharge Requirements.

^b Based on the 1995 RWQCB 5c Basin Plan. [http://www.swrcb.ca.gov/rwqcb5/available_documents/index.html#anchor616381]

^c Collect monthly samples. The first sample shall be collected at the start of the discharge and the last sample shall be collected at the completion of the discharge. Use the same sample collection criteria for discharges less than one month in duration for a total of two samples per discharge event.

^d Each constituent will be analyzed in the effluent and the two receiving water samples.

^e Bacteria, chemical constituents, pesticides, radioactivity, salinity, and temperature shall be analyzed for a specific beneficial use as noted in the Basin Plan. Ammonia is suspected at elevated levels.

^f R-1 shall be collected 100 feet upstream from the closest point of discharge. R-2 shall be collected 100 feet downstream from the closest point of discharge.

^g If the results from receiving water sample exceed any of the discharge limits then discontinue dewatering activities to surface water

^h All discharge limitations are listed in the Water Quality Objectives Section of the Basin Plan

ⁱ Water shall not contain concentrations that cause nuisance or adversely affect beneficial uses of the following: Biostimulatory substances, color, floating material, oil and grease, sediment, settleable material, suspended material, tastes and odors, and toxicity.



Dewatering Operations

NS-2

STORM WATER DEWATERING OPERATIONS BMP DISCHARGE MONITORING FORM^a	
Lahontan Region (RWQCB 6) For Surface Waters ^b	
GENERAL INFORMATION	
Project Name	
Contract No	
Contractor	
Sampler's Name	
Sampler's Signature	
Date Discharge Began	
Date of Sampling	

WATER SAMPLE LOG ^{c, d, e}			
Constituents	Units	Results	
		Effluent	Receiving Water ^f
			Upstream (R-1) Downstream (R-2)
pH	unitless		
Turbidity	NTUs		

DISCHARGE LIMITATIONS ^{g, h, i}			
Constituent	Units	EFFLUENT	RECEIVING WATER
		Daily Maximum	Daily Maximum
pH	unitless	--	Between 6.5 - 8.5 ^j
Turbidity	NTUs	--	10% of Ambient ^j

NOTES:

Ambient - Upstream sample result (i.e., R-1)

BMP - Best Management Practice

NTUs - Nephelometric turbidity units

mg/L - Milligrams per liter

RWQCB - Regional Water Quality Control Board

-- - Not required

> - Greater Than

^a This form shall be used only for dewatering of storm water/accumulated precipitation. Dewatering non-storm water shall monitor constituents required in the applicable NPDES permit or Waste Discharge Requirements.

^b All surface waters including wetlands. Based on the 1994 RWQCB 6 Basin Plan.

[http://www.swrcb.ca.gov/rwqcb6/BPlan/BPlan_Index.htm]

^c Collect monthly samples. The first sample shall be collected at the start of the discharge and the last sample shall be collected at the completion of the discharge. Use the same sample collection criteria for discharges less than one month in duration for a total of two samples per discharge event.

^d Each constituent will be analyzed in the effluent and the two receiving water samples.

^e pH and turbidity are required to be analyzed throughout the basin, however, adjusted sodium adsorption ration, algal growth potential, biological indicators, biostimulatory substances, boron, chemical constituents, chlorophyll-a, clarity, color, dissolved inorganic nitrogen, dissolved orthophosphate, dissolved oxygen, electrical conductivity, fluoride, iron, nitrogen as nitrate, pesticides, plankton counts, radioactivity, sodium adsorption ratio, soluble reactive iron, soluble reactive phosphorous, species composition, sulfate, suspended sediment, tastes & odors, temperatures, total dissolved solids, total alkalinity as carbonate, total kjeldahl nitrogen, total nitrogen, total phosphorous, total reactive iron, toxicity, transparency, un-ionized ammonia shall be analyzed if the project lies in an area designated for a specific beneficial use, as noted in the Basin Plan. Bacteria/Coliform if high levels are suspected. Residual chlorine if suspected to be present.

^f R-1 shall be collected 100 feet upstream from the closest point of discharge. R-2 shall be collected 100 feet downstream from the closest point of discharge.

^g If the results from receiving water sample exceed any of the discharge limits then discontinue dewatering activities to surface waters

^h All discharge limitations are listed in the Water Quality Objectives Section of the Basin Plan.

ⁱ Water shall not contain concentrations that cause nuisance or adversely affect beneficial uses of the following: Floating material, nondegradation of aquatic communities and populations, oil and grease, sediment, settleable materials, and suspended materials.

^j In addition, bacteria/coliform, pH, total residual chlorine, and turbidity have specific beneficial uses and/or location specific discharge limitations. See basin plan for specific limitations.



Dewatering Operations

NS-2

STORM WATER DEWATERING OPERATIONS BMP DISCHARGE MONITORING FORM ^a	
Colorado River Basin Region (RWQCB 7) For Surface Waters ^b	
GENERAL INFORMATION	
Project Name	
Contract No.	
Contractor	
Sampler's Name	
Sampler's Signature	
Date Discharge Began	
Date of Sampling	

WATER SAMPLE LOG ^{c, d, e}			
Constituents	Units	Results	
		Effluent	Receiving Water ^f
			Upstream (R-1) Downstream (R-2)
pH	unitless		
TDS ^g	mg/L		

DISCHARGE LIMITATIONS ^{g, h, i}			
Constituent	Units	EFFLUENT	RECEIVING WATER
		Daily Maximum	Daily Maximum
pH	unitless	--	Between 6.0 - 9.0
TDS ^g	mg/L	--	See Basin Plan

NOTES:

- BMP - Best Management Practice
- RWQCB - Regional Water Quality Control Board
- - Not required
- > - Greater Than

^a This form shall be used only for dewatering of storm water/accumulated precipitation. Dewatering non-storm water shall monitor constituents required in the applicable NPDES permit or Waste Discharge Requirements.

^b Based on the 2002 RWQCB 7 Water Quality Plan.

[<http://www.swrcb.ca.gov/rwqcb7/documents/RB7Plan.pdf>]

^c Collect monthly samples. The first sample shall be collected at the start of the discharge and the last sample shall be collected at the completion of the discharge. Use the same sample collection criteria for discharges less than one month in duration for a total of two samples per discharge event.

^d Each constituent will be analyzed in the effluent and the two receiving water samples.

^e Bacteria, biochemical oxygen demand, chemical constituents, chemical oxygen demand, dissolved oxygen, radioactivity, and selenium shall be analyzed for specific beneficial uses as noted in the Basin Plan.

^f R-1 shall be collected 100 feet upstream from the closest point of discharge. R-2 shall be collected 100 feet downstream from the closest point of discharge.

^g Total Dissolved Solids (TDS) has specific location discharge limitations. See basin plan for specific limitations.

^h If the results from receiving water sample exceed any of the discharge limits then discontinue dewatering activities to surface waters

ⁱ All discharge limitations are listed in the Water Quality Objectives Section of the Basin Plan.

^j Water shall not contain concentrations that cause nuisance or adversely affect beneficial uses of the following: Biostimulatory substances, color, floating material, herbicides, oil and grease, pesticides, sediment, settleable and suspended solids, tainting substances, tastes and odors, temperature, toxicity, and turbidity.



Dewatering Operations

NS-2

STORM WATER DEWATERING OPERATIONS BMP DISCHARGE MONITORING FORM ^a	
Santa Ana Region (RWQCB 8) For Inland Surface Waters ^b	
GENERAL INFORMATION	
Project Name	
Contract No	
Contractor	
Sampler's Name	
Sampler's Signature	
Date Discharge Began	
Date of Sampling	

WATER SAMPLE LOG ^{c, d, e}				
Constituents	Units	Results		
		Effluent	Receiving Water ^f	
			Upstream (R-1)	Downstream (R-2)
pH	unitless			
Turbidity	NTUs			
TDS	mg/L			

DISCHARGE LIMITATIONS ^{g, h, i, j}			
Constituent	Units	EFFLUENT	RECEIVING WATER
		Daily Maximum	Daily Maximum
pH	unitless	--	Between 7.0 - 8.6 (bays and estuaries)
		--	Between 6.5 - 8.5 (inland surface waters)
Turbidity	NTUs	--	20% (Where Ambient is 0 - 50 NTUs)
			10 NTUs (Where Ambient is 50 - 100 NTUs)
			10% (Where Ambient is > 100 NTUs)
TDS	mg/L	--	See Table 4-1 in Basin Plan

NOTES:

Ambient - Upstream sample result (i.e., R-1)

BMP - Best Management Practice

NTUs - Nephelometric turbidity units

mg/L - Milligrams per liter

RWQCB - Regional Water Quality Control Board

-- - Not required

> - Greater Than

^a This form shall be used only for dewatering of storm water/accumulated precipitation. Dewatering non-storm water shall monitor constituents required in the applicable NPDE permit or Waste Discharge Requirements.

^b All inland surface waters including streams, rivers, lakes, and wetlands. Based on the 1995 RWQCB 8 Basin Plan. [http://www.swrcb.ca.gov/rwqcb8/pdf/R8BPlan.pdf]

^c Collect monthly samples. The first sample shall be collected at the start of the discharge and the last sample shall be collected at the completion of the discharge. Use the same sample collection criteria for discharges less than one month in duration for a total of two samples per discharge event.

^d Each constituent will be analyzed in the effluent and the two receiving water samples.

^e Bacteria/coliform, dissolved oxygen, fluoride, methylene blue-activated substances (MBAS), metals, nitrate, radioactivity, temperature, and un-ionized ammonia shall be analyzed for a specific beneficial use, as noted in the Basin Plan. Boron, Residual Chlorine, Hardness, sodium, chloride, total inorganic nitrogen, sulfate, and chemical oxygen demand if present at elevated levels.

^f R-1 shall be collected 100 feet upstream from the closest point of discharge. R-2 shall be collected 100 feet downstream from the closest point of discharge.

^g If the results from receiving water sample exceed any of the discharge limits then discontinue dewatering activities to surface waters.

^h All discharge limitations are listed in the Water Quality Objectives Section of the Basin Plan.

ⁱ Water shall not contain concentrations that cause nuisance or adversely affect beneficial uses of the following: Algae, color, floatables, oil and grease, suspended & settleable solids, sulfides, surfactants, tastes and odors, and toxic substances.

^j Total dissolved solids (TDS), hardness, sodium (Na), chloride (Cl), total inorganic nitrogen (TIN), sulfate (SO₄) and chemical oxygen demand (COD) shall be analyzed for specific waterbodies as identified in the Basin Plan.



Dewatering Operations

NS-2

STORM WATER DEWATERING OPERATIONS BMP DISCHARGE MONITORING FORM ^a	
San Diego Region (RWQCB 9) For Inland Surface Waters ^d	
GENERAL INFORMATION	
Project Name	
Contract No	
Contractor	
Sampler's Name	
Sampler's Signature	
Date Discharge Began	
Date of Sampling	

WATER SAMPLE LOG ^{c, d, e}				
Constituents	Units	Results		
		Effluent	Receiving Water ^f	
			Upstream (R-1)	Downstream (R-2)
pH	unitless			
Turbidity	NTUs			
TDS	mg/L			
Dissolved Oxygen	mg/L			
Color				

DISCHARGE LIMITATIONS ^{g, h, i}			
Constituent	Units	EFFLUENT	RECEIVING WATER
		Daily Maximum	Daily Maximum
pH	unitless	--	Between 6.5 - 8.5
Turbidity	NTUs	--	20% (Where Ambient is 0 - 50 NTUs) 10 NTUs (Where Ambient is 50 - 100 NTUs) 10% (Where Ambient is > 100 NTUs) 0.2 NTUs (ocean waters)
TDS	mg/L		See Table 3-2 in Basin Plan
Dissolved Oxygen	mg/L		5.0 mg/l in inland surface waters 6.0 mg/l in waters with designated COLD beneficial uses
Color		--	See Table 3-2 in Basin Plan

NOTES:

Ambient - Upstream sample result (i.e., R-1)
BMP - Best Management Practice
NTUs - Nephelometric turbidity units
mg/L - Milligrams per liter

RWQCB - Regional Water Quality Control Board
-- - Not required
> - Greater Than

a This form shall be used only for dewatering of storm water/accumulated precipitation. Dewatering non-storm water shall monitor constituents required in the applicable NPDES permit or Waste Discharge Requirements.

b All inland surface waters, enclosed bays, and estuaries and coastal lagoons. Based on the 1994 RWQCB 9 Basin Plan.

[<http://www.swrcb.ca.gov/rwqcb9/programs/basinplan.html>]

c Collect monthly samples. The first sample shall be collected at the start of the discharge and the last sample shall be collected at the completion of the discharge. Use the same sample collection criteria for discharges less than one month in duration for a total of two samples per discharge event.

d Each constituent will be analyzed in the effluent and the two receiving water samples.

e Bacteria, E. Coli & enterococci, biostimulatory substances, dissolved oxygen, inorganic chemicals, organic chemicals, pesticides, phenolic compounds, radioactivity, tastes & odors, temperatures, and trihalomethanes shall be analyzed for specific beneficial use, as noted in the Basin Plan.

Un-ionized Ammonia, chloride, sulfate, sodium, iron, manganese, MBAS, boron, and fluoride if suspected at elevated levels.

f R-1 shall be collected 100 feet upstream from the closest point of discharge. R-2 shall be collected 100 feet downstream from the closest point of discharge.

g If the results from receiving water sample exceed any of the discharge limits then discontinue dewatering activities to surface waters.

h All discharge limitations are listed in the Water Quality Objectives Section of the Basin Plan.

i Water shall not contain concentrations that cause nuisance or adversely affect beneficial uses as required in the Basin Plan.

